

NOTE: ELECTRICAL PANEL MUST BE MOUNTED IN A DRY LOCATION WITH AN AMBIENT TEMP UNDER 150 DEG F


ELECTRICAL PANEL P/N 550-005

POS. BATTERY TERMINAL 4 GA WIRE PROVIDED BY OTHERS

UNPLUG OEM LOW PRESSURE SWITCH AT ACCUMULATOR. CUT PURPLE WIRE HARNES SIDE TO BLACK WIRE.

PURPLE OEM(HARNES SIDE)

PURPLE OEM(PLUG SIDE)

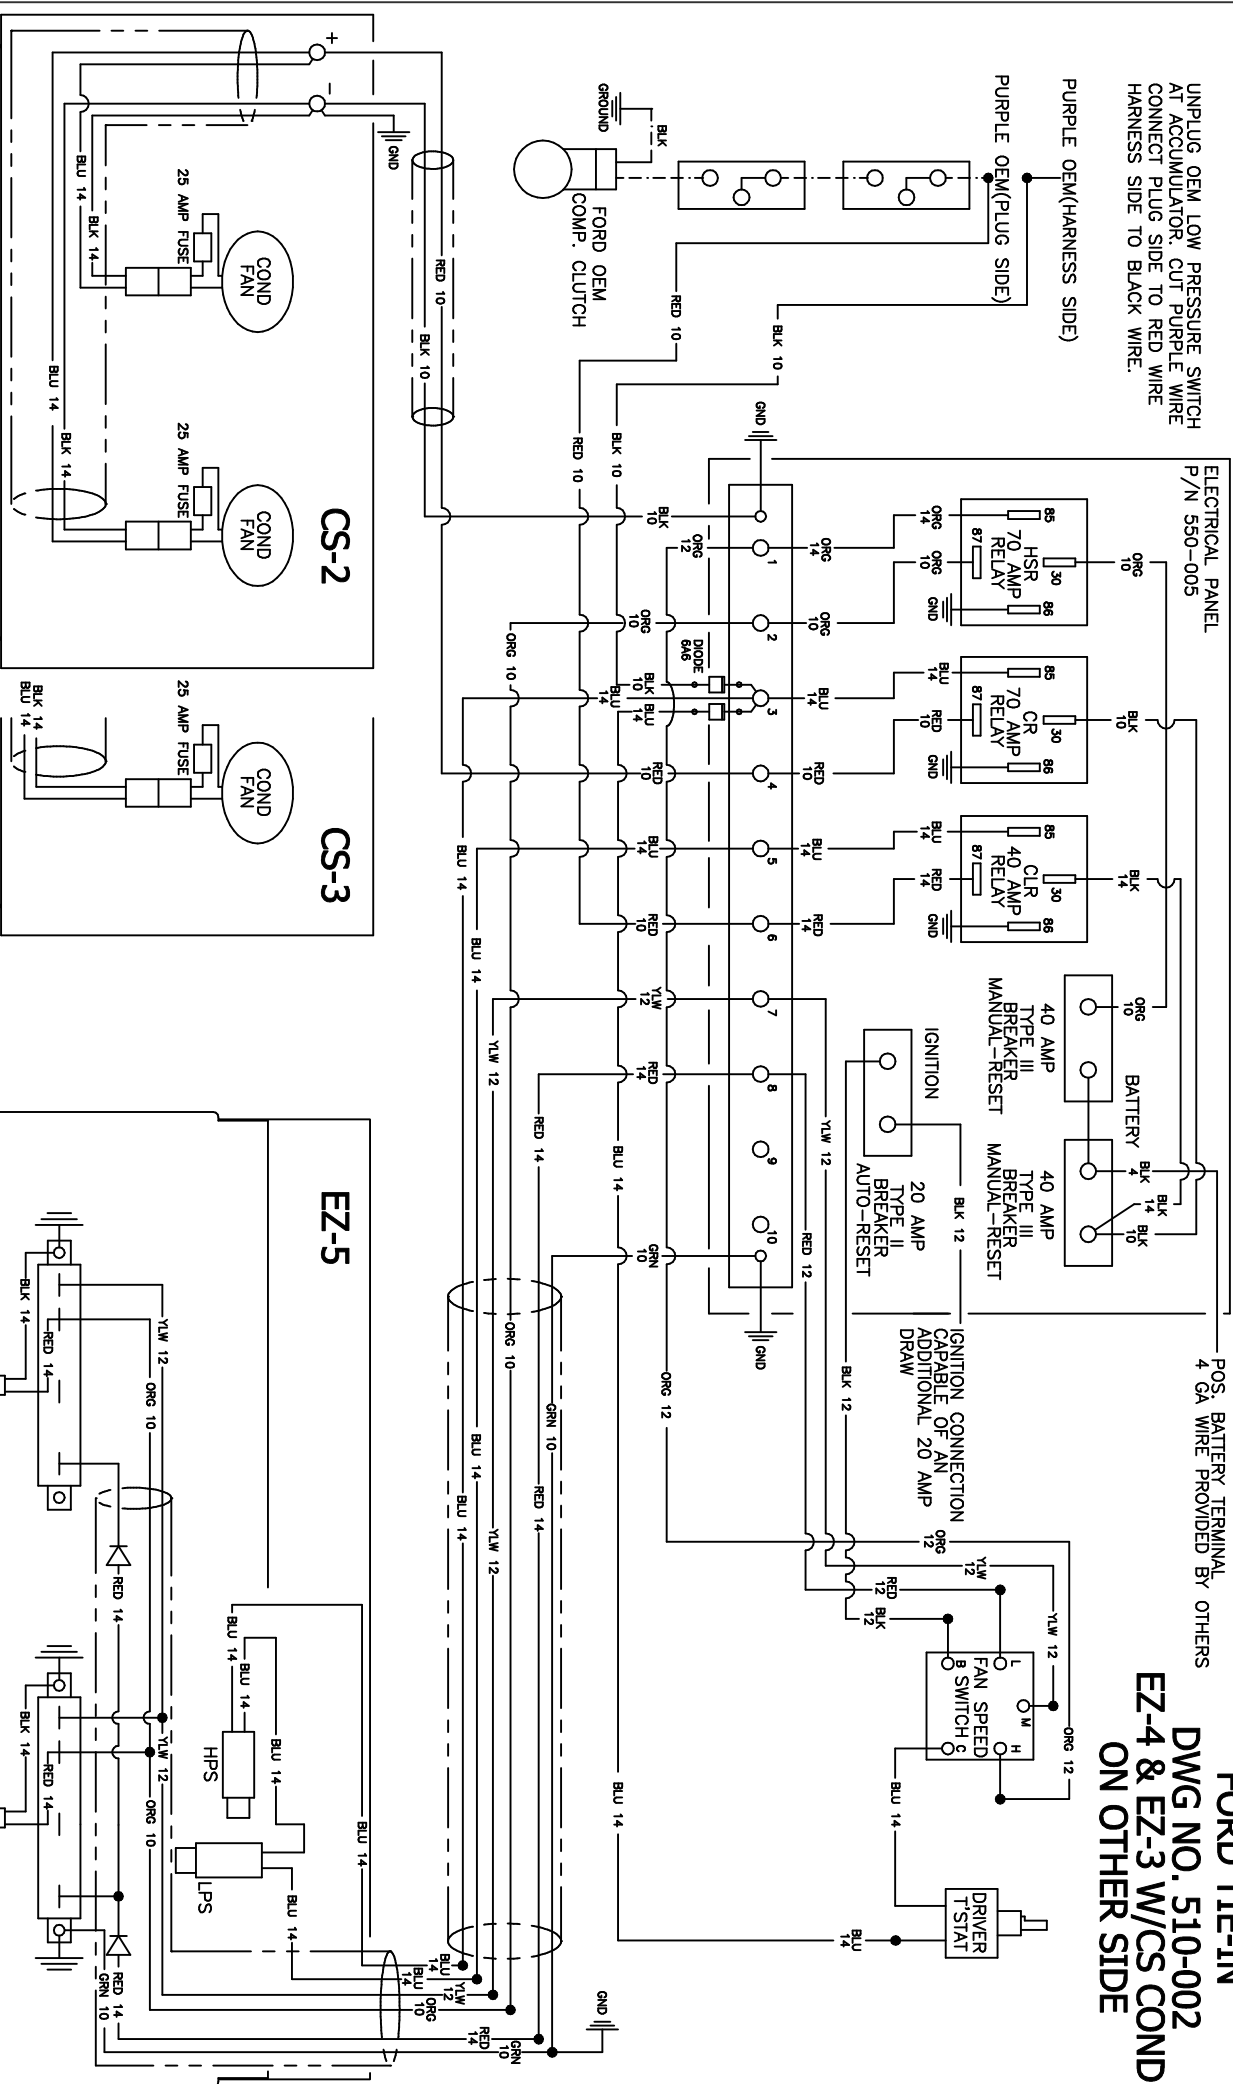

WIRING DIAGRAM
EZ-5 W/CS SERIES COND
FORD TIE-IN
DWG NO. 510-002
EZ-4 & EZ-3 W/CS COND
ON OTHER SIDE



AMERICAN COOLING TECHNOLOGY, Inc.

715 WILLOW SPRINGS LANE

YORK, PA 17406

FAX: (717) 767-3658

(717) 767-2775