

WIRING DIAGRAM

EZ-5 W/CS SERIES COND

DWG NO. 510-005


EZ-4 & EZ-3 W/CS COND

ON OTHER SIDE

NOTE: ELECTRICAL PANEL MUST BE MOUNTED IN A DRY LOCATION WITH AN AMBIENT TEMP UNDER 150 DEG F

ELECTRICAL PANEL
P/N 550-005

POS. BATTERY TERMINAL
4 GA WIRE PROVIDED BY OTHERS

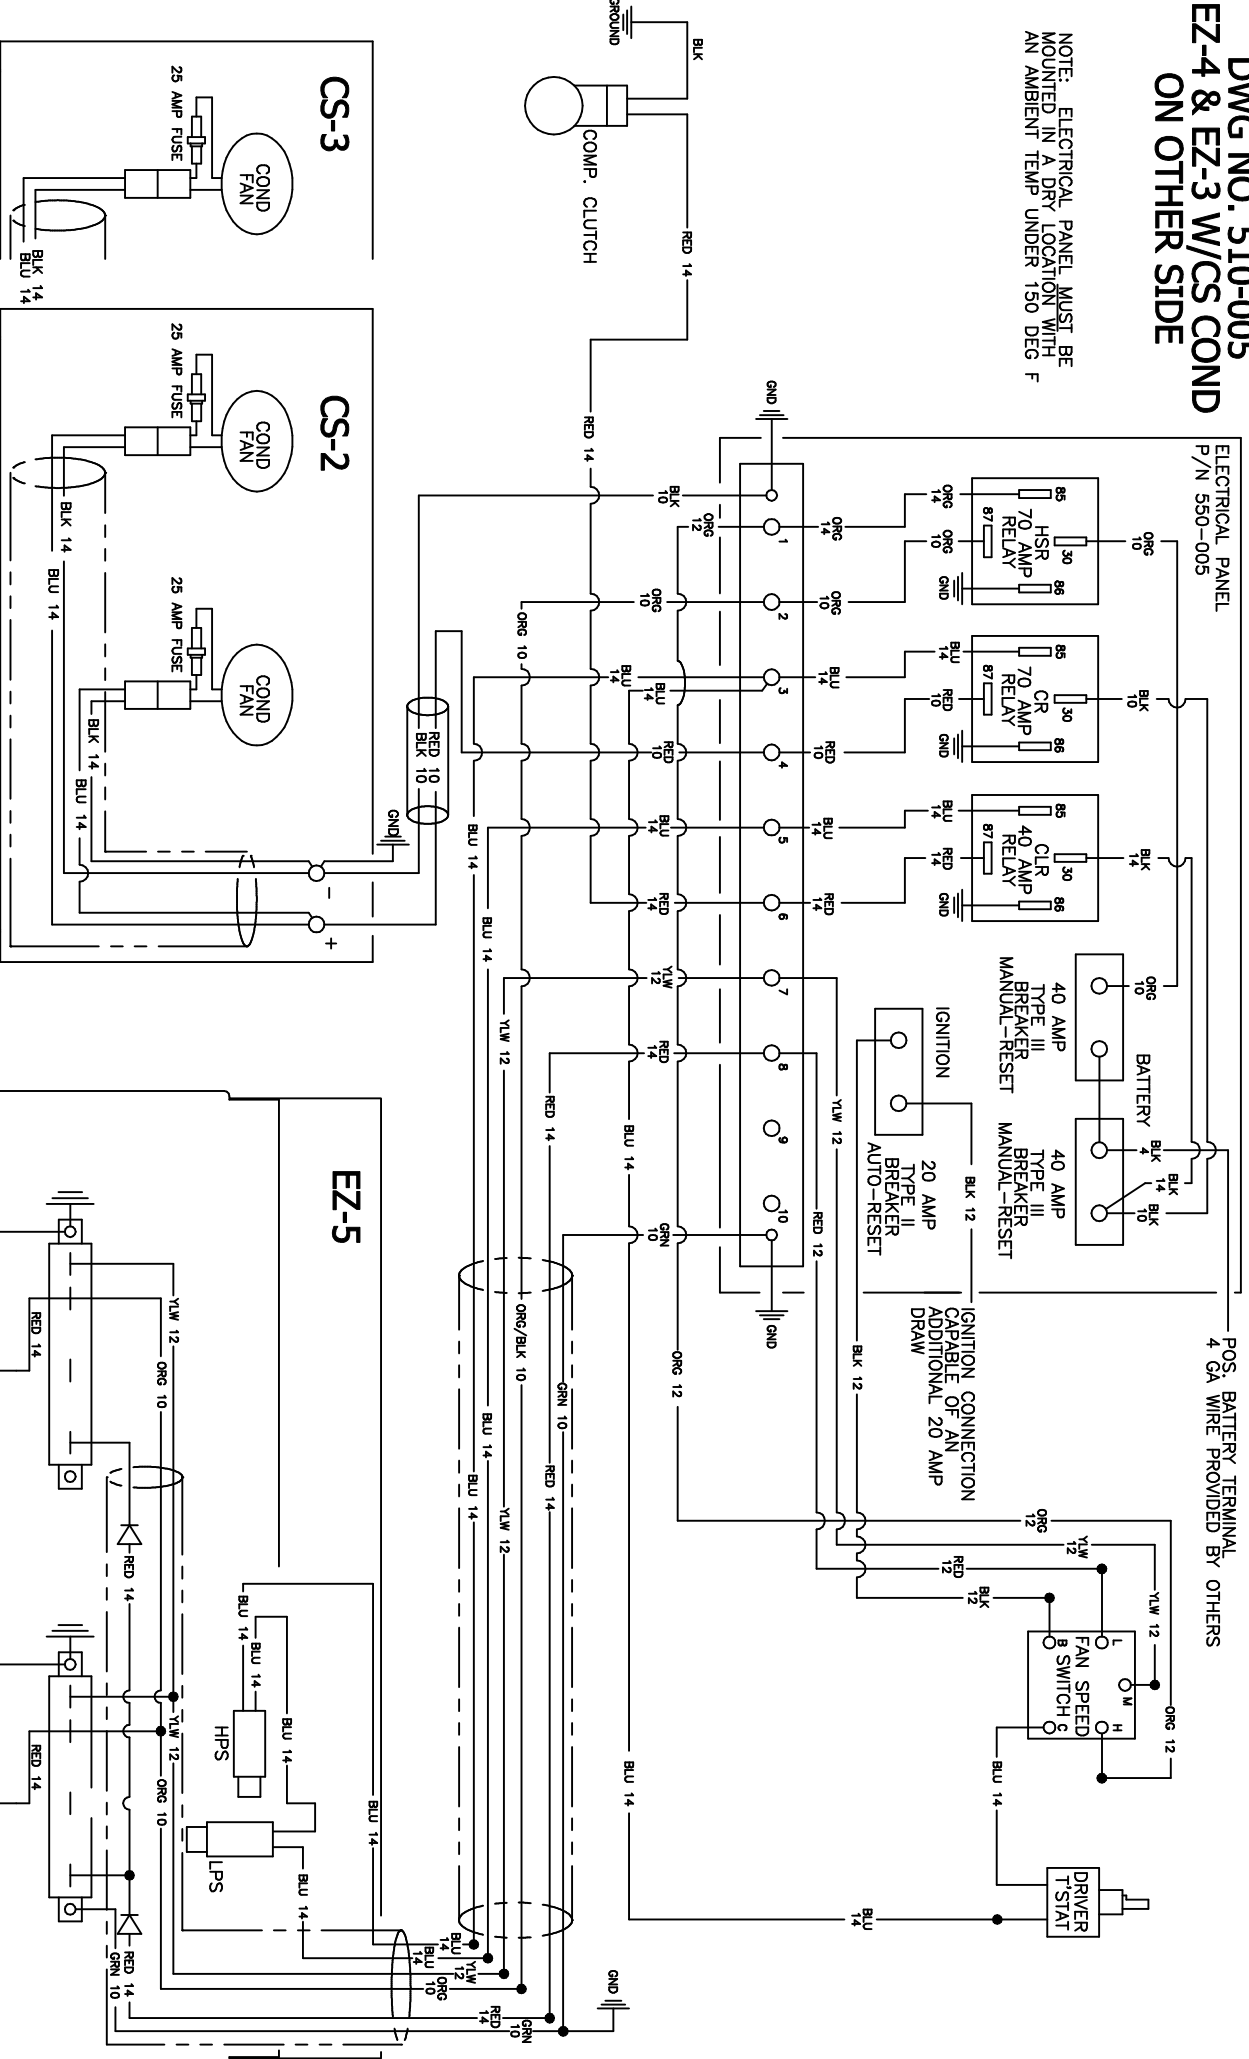

AMERICAN COOLING TECHNOLOGY, Inc.
715 WILLOW SPRINGS LANE
YORK, PA 17406
FAX: (717) 767-3658
(717) 767-2775