




AMERICAN COOLING TECHNOLOGY, INC.  
715 WILLOW SPRINGS LANE  
YORK, PA. 17402  
FAX: (717) 767-3658  
(717) 767-2775

# WIRING DIAGRAM EZ-9 W/ (2) CS SERIES COND DWG NO. 510-036

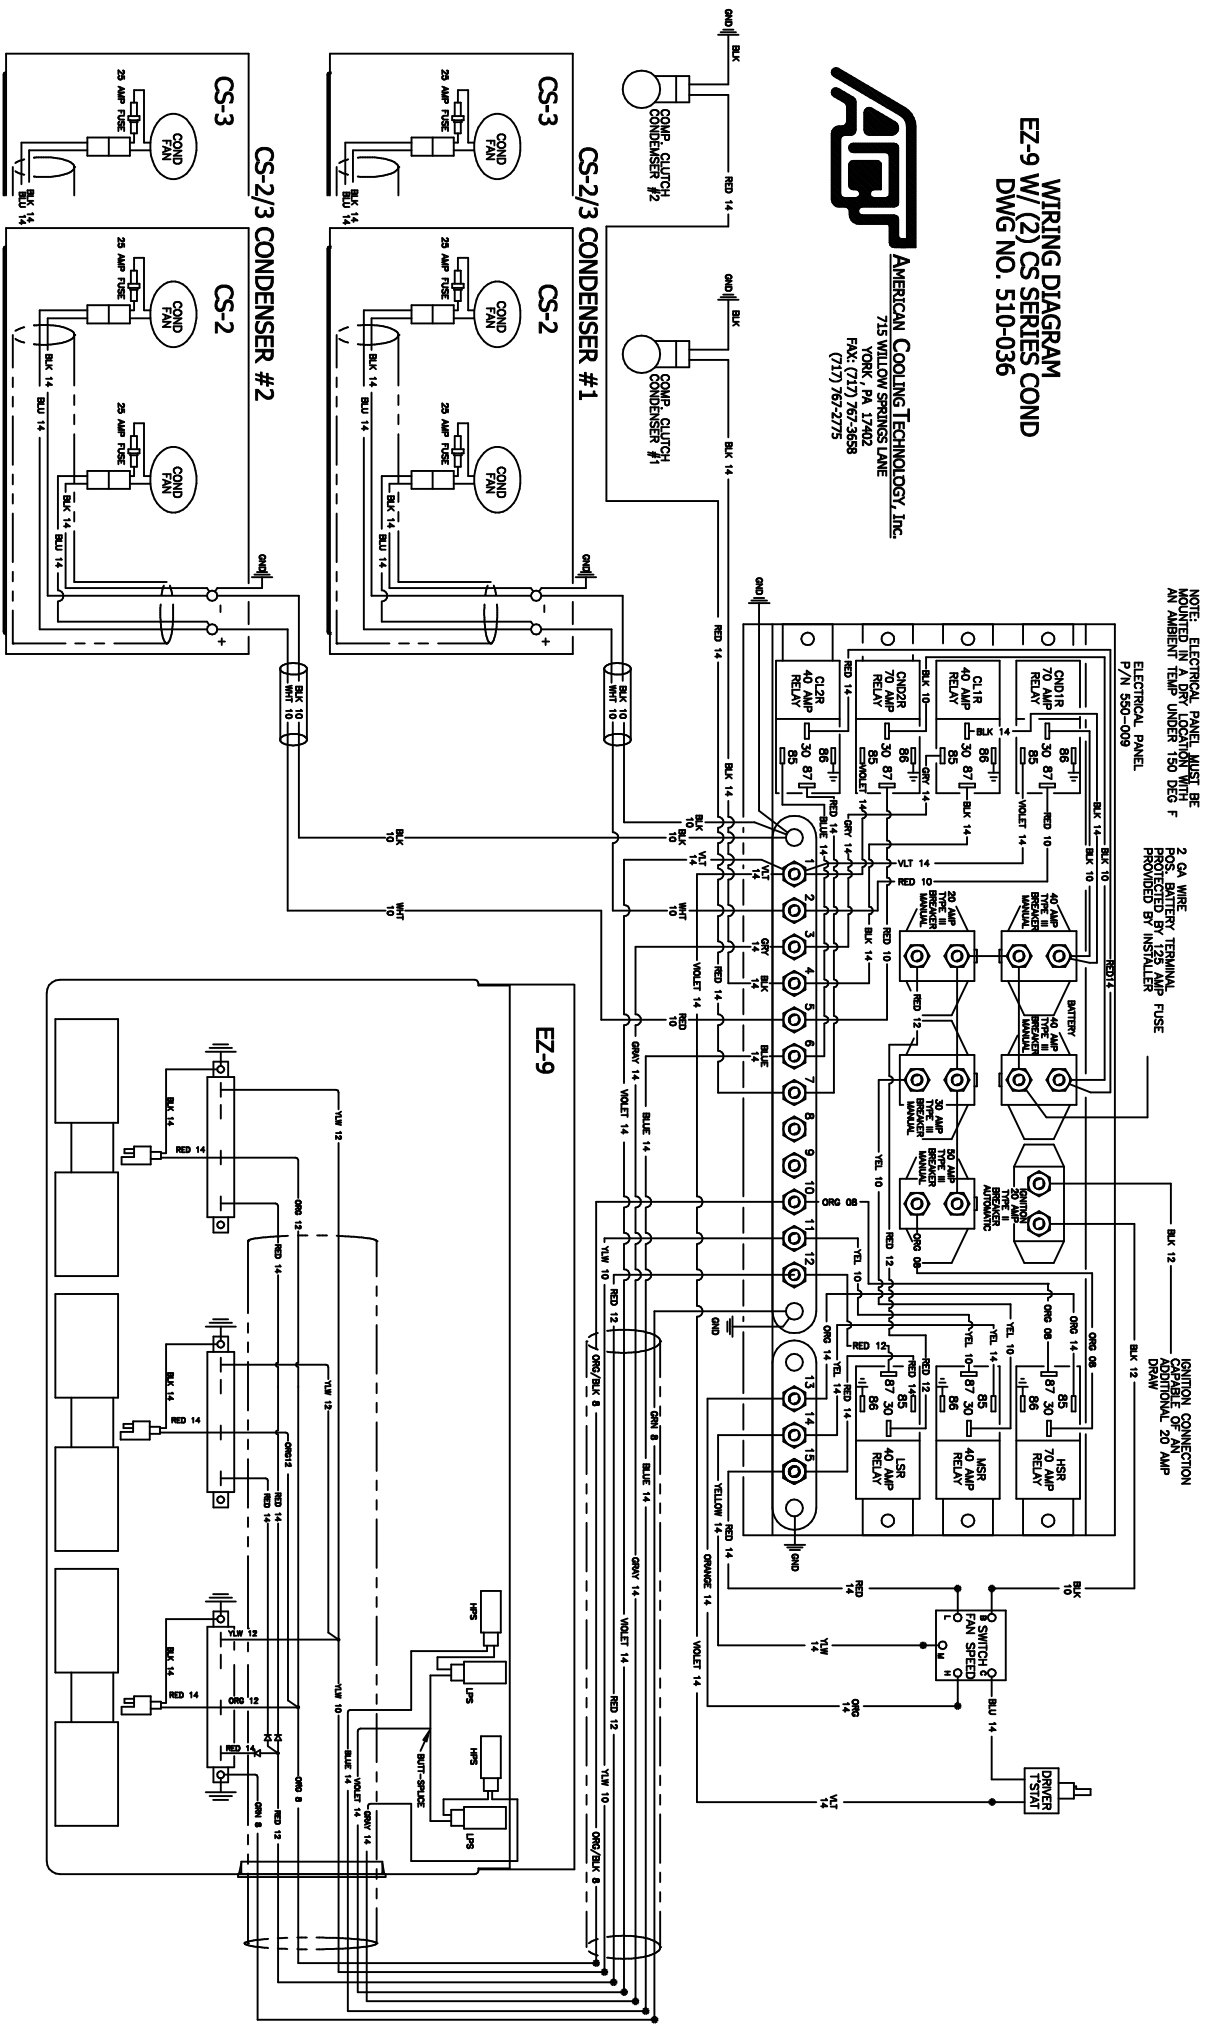

NOTE: ELECTRICAL PANEL MUST BE PROTECTED BY 20 AMP FUSE AT AMBIENT TEMP UNDER 150 DEG F

20 AMP WIRE TERMINAL PROTECTED BY 125 AMP FUSE PROVIDED BY INSTALLER

IGNITION CONNECTION CAPABLE OF AN ADDITIONAL 20 AMP DRAW

ELECTRICAL PANEL P/N 550-009